


TYPICAL NOTES:

- 1) - ALL EXPOSED PIPING AND FITTINGS TO BE GALVANIZED WITH EXCEPTION OF STORZ CONNECTION
- 2) - 40' MAX. FROM FDC TO FIRE APPARATUS ACCESS (DRIVEWAY)
- 3) - FOR NFPA 13R SYSTEMS (2 1/2" RISER AND SMALLER) SINGLE FDC
- 4) - FOR HIGH RISE BUILDINGS USE SIAMESE
- 5) - AN APPROVED CONNECTION (TAPPING NOT APPROVED)

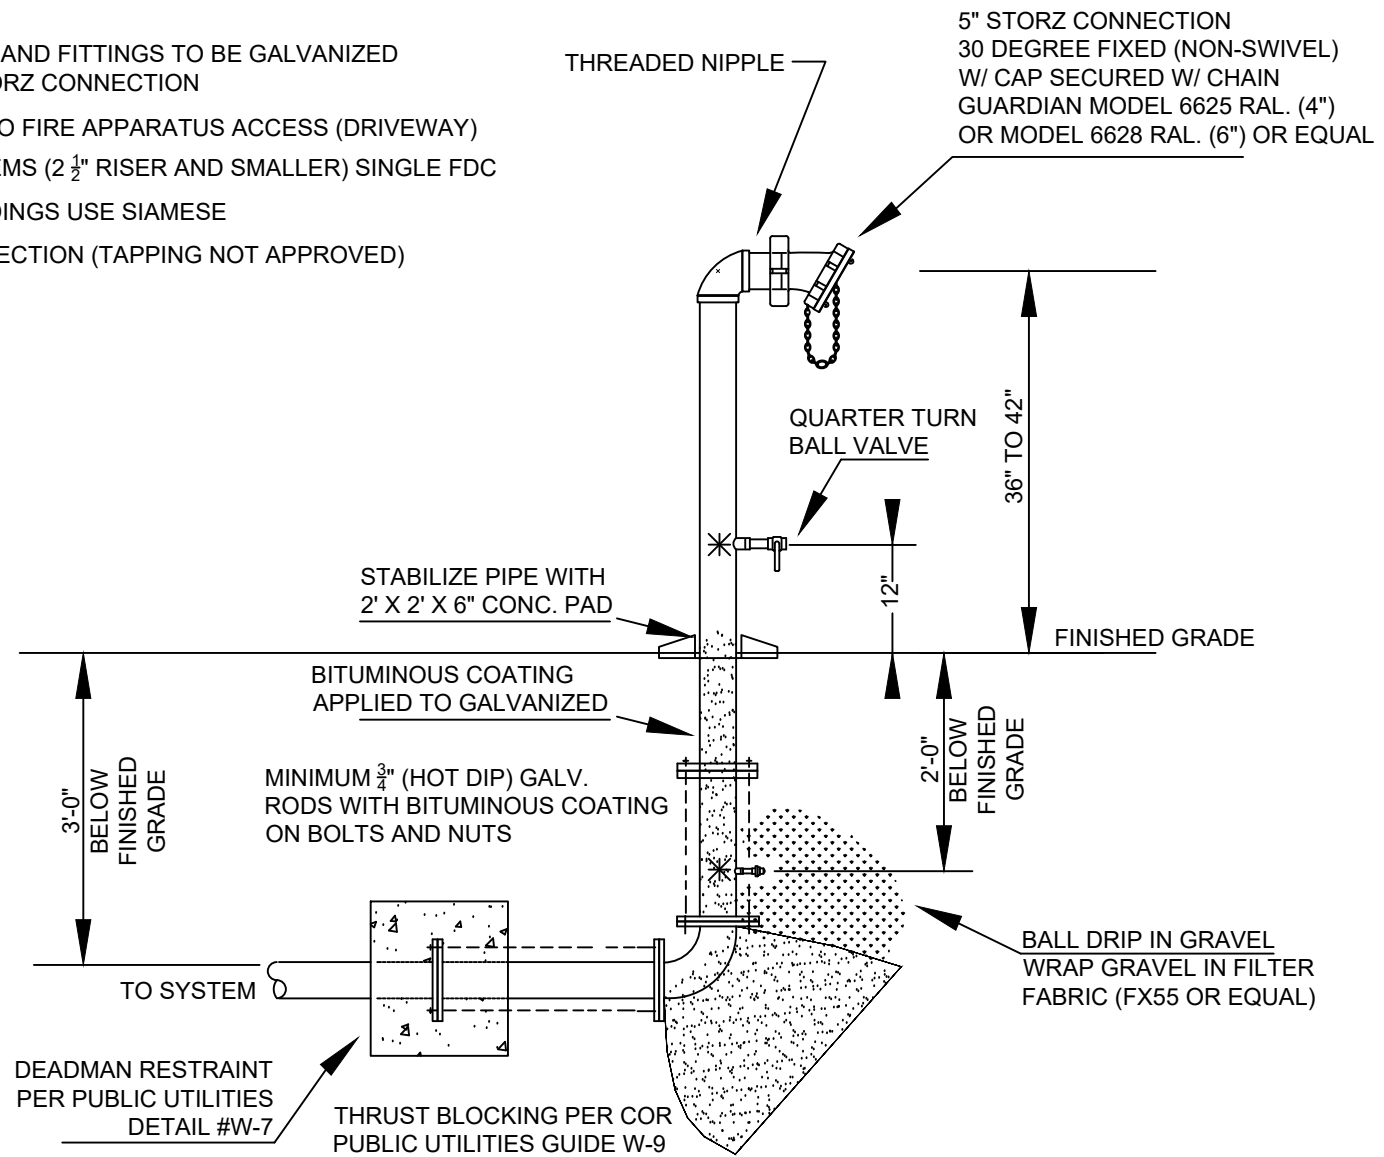

NOT TO SCALE

YARD FIRE DEPARTMENT CONNECTION

MARCH 2024

351