




NOTES:

1. ENSURE FLUSH CONDITIONS AT CURB RAMP TO GUTTER TRANSITION.
2. TYPICALLY, THE SIDEWALK RUNNING SLOPE SHALL NOT EXCEED THE GENERAL GRADE ESTABLISHED FOR THE ADJACENT STREET.
3. IF THE SLOPE FROM FLOWLINE TO BACK OF CURB AT RAMP IS LESS THAN 8.33%, THEN THE SLOPE FROM LIP TO FLOWLINE AT RAMP MAY EXCEED 5% AS LONG AS THE ALGEBRAIC DIFFERENCE BETWEEN THESE TWO SLOPES IS LESS THAN 13.33%.
4. CURB RAMPS WITH RETURNED CURBS MAY BE USED ONLY WHERE PEDESTRIANS WOULD NOT TYPICALLY WALK ACROSS THE RAMP. THE ADJACENT SURFACE IS PLANTING OR OTHER NON-WALKING SURFACE.

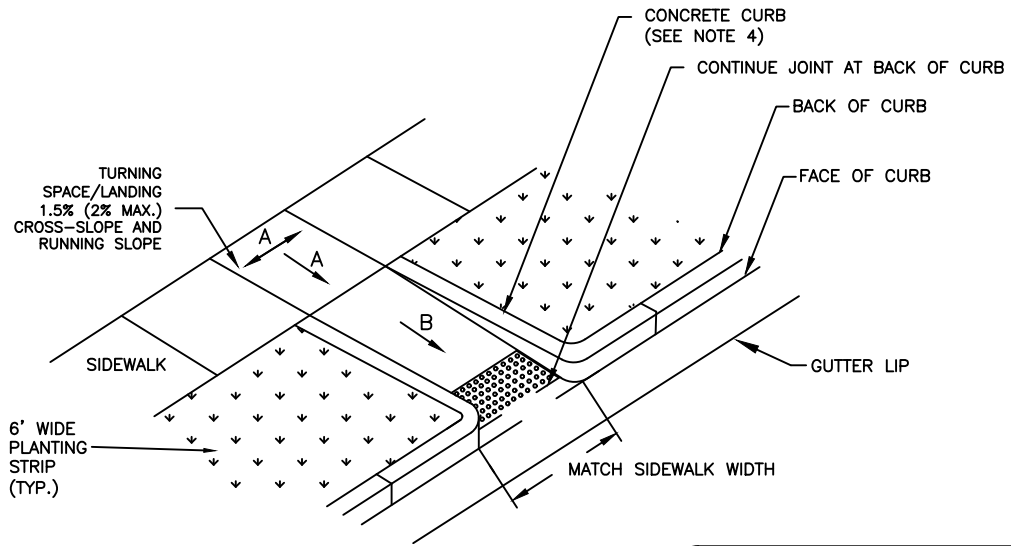

SLOPE "A" = UP TO 1.5% (2.00% MAX)
 SLOPE "B" = UP TO 7.5% (8.33% MAX)

PLAN VIEW

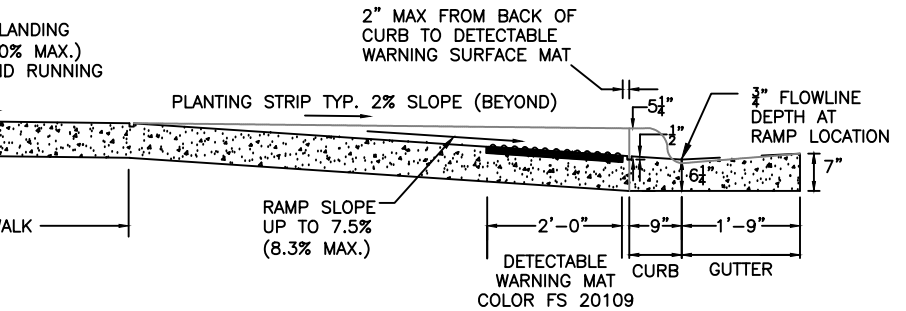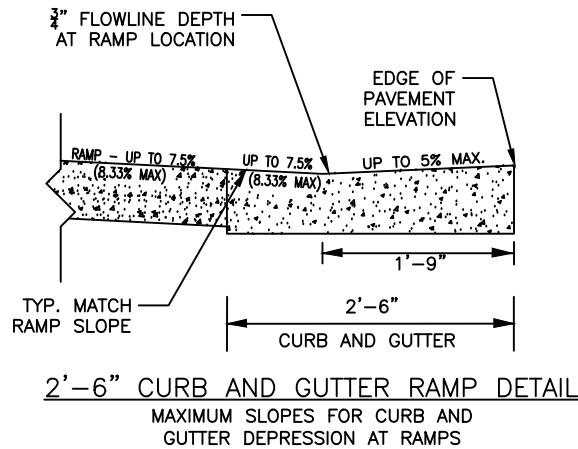

TYPICAL RAMP SECTION AT CENTERLINE

NOT TO SCALE



**PERPENDICULAR CURB RAMP
 WITH 2'-6" CURB & GUTTER**